

P.R. NO. 321261

RFQ NO. 44080

TENDER NOTICE NO.: 11/2017-2018

TENDER

Tender for : Replacement of failed TC/Aug. of TC. Under Deodar-I S/Dn

(1)	Estimated Cost.:-	RS.10,00,000.00	
(2)	Earnest Money Deposit:-	Rs. 10,000.00	
(3)	Security Deposit :-	5% of Order Value	
(4)	Last date for on line tender submission & (Tender fees & EMD only DD) of receipt of tender at	Date:-07-09-2017	Time upto 15.00 PM
(5)	Last Date & Time of Receiving of Tender:-	Date:-08-09-2017	Time upto 15.00 PM
(6)	Date & Time of Opening of Tender.(If Possible)	Date:-11-09-2017	Time at 16.00 PM.
(7)	Tender Fee :- (Non Refundable)	Rs. 1000.00 + 18% GST	
(8)	Receipt No.& Date.	No.	Dt.
(9)	Time Limit:-	12 Months.	

Supdt.of A/c (Exp)
RADHANPUR

Executive Engineer
UGVCL,D.O, RADHANPUR

Issued to :

1) Tender value

(To be filled by the contractor)

Rs. _____

2) Earnest Money Deposit

Paid vide receipt No:


Date: _____

3) PAN NO: . _____

4) P.F. CODE NO. _____


UGVCL
Uttar Gujarat Vij Company Ltd.

5) Sale Tax No . _____ Date: _____

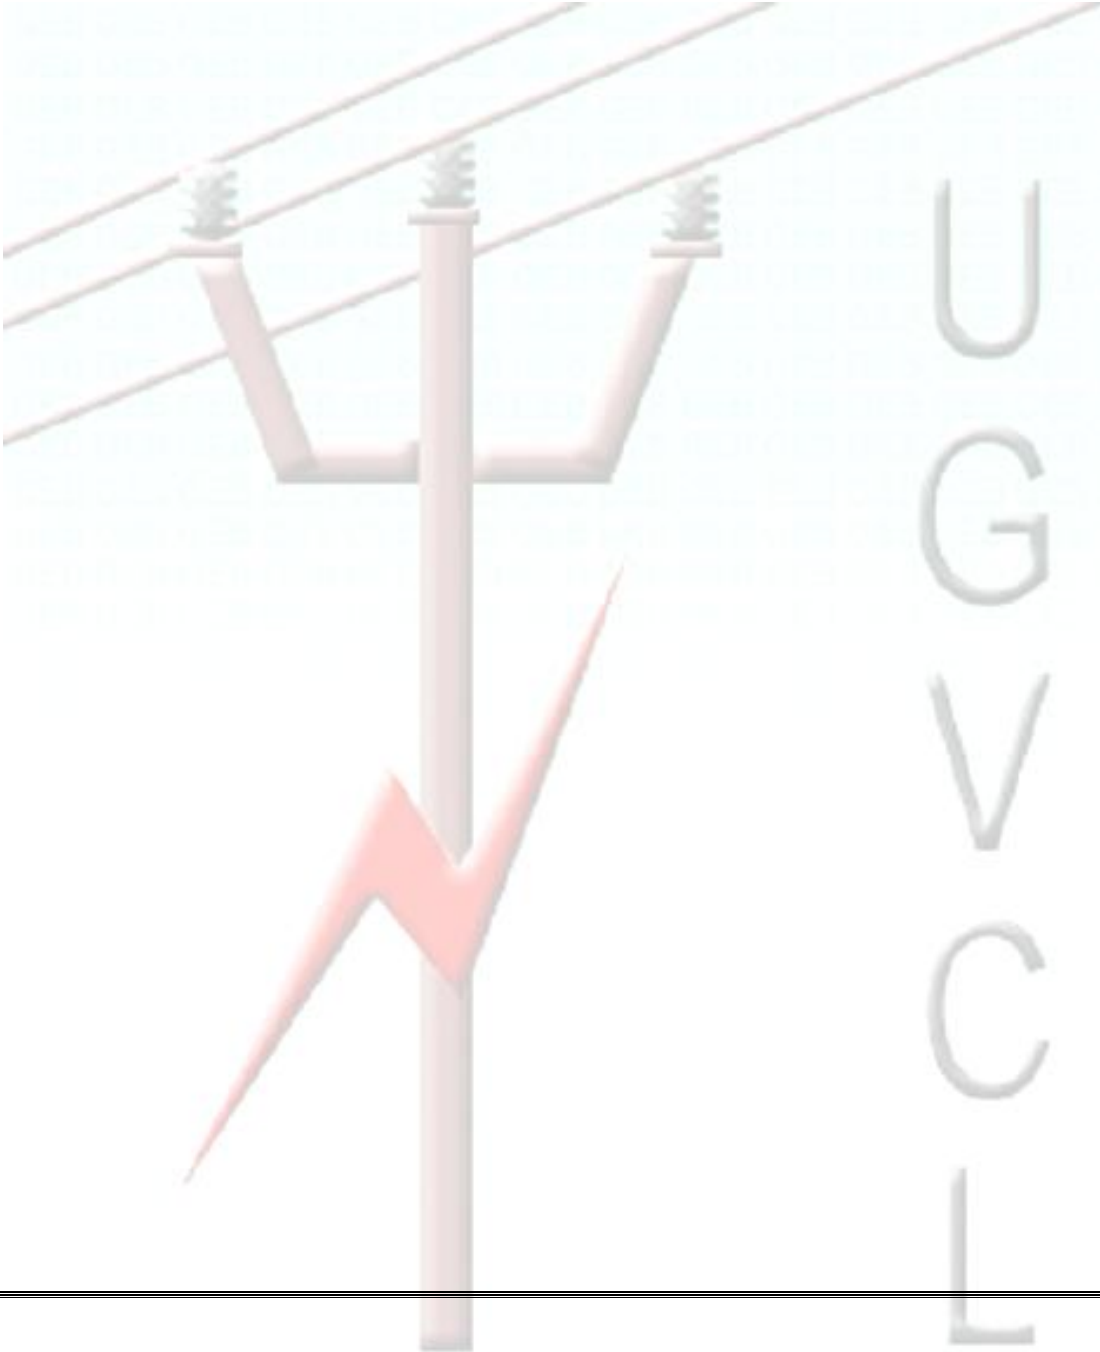

SCHEDULE: B

Sub : Open Tender for Replacement of Failed Transformer/Augmentation of Transformer by Labour Charge at Deodar-I Sub Division under Radhanpur Division.

Sr. No.	DESCRIPTION OF ITEMS	QNT	UNIT	RATE	AMOUNT
------------	----------------------	-----	------	------	--------



Uttar Gujarat Vij Company Ltd.

1	Replacement of Failed Distribution transformer by Repaired/New Transformer or Augmentation of working transformer at site under jurisdiction of Deodar-II S/Dn. - New/Repaired Transformer will be issued from Radhanpur division store and Old Failed or Working Transformer should be credited to Radhanpur DO Store. - All wiring work carried out by Contractor.	571	Nos.	1750	999250.00
			Total	RS.	999250.00

The rates quoted are _____% above/bellow to the scheduled rates as shown in SCHEDULE -B above.

Note :- Work to be carried out as per site situation & instruction of Engineer/Employee In charge.

**EXECUTIVE ENGINEER
UGVCL, DO, RADHANPUR.**

Contractor's signature with seal.

General Terms and Condition:-

- (1) It will be necessary to write with colour the name of the village, C. R. No. & date of replacement of the failed transformer on all the failed transformers at the cost of contractor only.
- (2) The contractor shall be responsible if the quantity of Oil in the failed transformer is found less than as measured on site.
- (3) An amount of 60% of the accepted rates will be paid if either only the failed transformer is credited in store or only any new transformer is installed i.e. if the single journey is performed.
- (4) Failed transformer has to be replaced within 24 hours from the date and time of issue of the same or Otherwise an amount of 100/- per day (or part thereof) shall be deducted as penalty.
- (5) An amount of 60% of the accepted rates will be paid if only augmentation of the transformer is to be done in the jurisdiction of the sub division.
- (6) Any replacement or augmentation has to be done in the presence of an authorized line staff of the concerned sub division.
- (7) An amount of 50% of the accepted rates will be paid if second transformer is to be replaced or augmented in the same village in a single day.
- (8) Failed transformer has to be credited within 72 hours from the date and time of replacement or otherwise an amount of 100/- per day (or part thereof) shall be deducted as penalty.
- (9) If situation arises than contractor has to carry out the same work in the jurisdiction of another sub division as per the rates of that concerned sub division only.
- (10) All the work as mentioned in the order has to be carried out with skilled labour only. Contractor Shall only be fully responsible in case of any loss and or damage to any person, property of the contractor and or the company.
- (11) The company shall provide only the transformer and contractor shall have to arrange at his cost any other material, accessories etc. required to carry the activities as per terms and conditions of the contract.
- (12) Experience certificate for Erection of HT,LT, & TC work done by contractor is provided with tender copy .

GENERAL INSTRUCTION TO TENDERERS

- 1 Sealed Tenders are invited for the work of Replacement of Failed Transformer/Augmentation of Transformer by Labour Charge at **Deodar-I Sub Division** under Radhanpur Division from the

contractors/firms who have executed works of similar nature and magnitude successfully and who are registered under appropriate class.

- 2 Tender documents are in two bids system i.e. “Technical Bid” and “Price Bid”.
 - A. Technical bid is to be submitted in a separate sealed envelope and super scribing the envelope as “Technical Bid”. Technical bid should be submitted with documents as under, failing which tender is liable for rejection.
 - B. Solvency certificate issued from any Nationalized Bank amounting to sum equivalent of estimated cost(**Minimum 10.0 Lacs**)
 - C. Separate EPF code No. allotted by RPFC & Last Six month of current year EPF Challan paid copy is required.
 - D. Latest income tax clearance certificate.
 - E. **GST NO/ PAN Number.**
 - A. GST No. & Date must be mentioned in Tender.
 - B. Pan Number & Date must be mentioned in Tender.

As per GST Act, UGVCL is in the process of amending various commercial Terms & Conditions of Tender. The following terms & conditions to be amended are given below.

Name of Terms & Conditions	To be added/amended
Tender fee	Plus applicable GST
Prices	Replace Excies duty, VAT/Sales Tax by GST
Excies Duty	Replace Excies duty, Sales Tax/VAT by GST
Sales/VAT (Value Added Tax)	
Octroi	To be dated

- F. Group Insurance copy of the insurance policy of the insured laborer’s under W.C. Act.
 - G. Experience certificate regarding similar nature work executed in any division of company for Rs. 10 lacs in three last financial year.
 - H. Details of equipments available with the tendered.
 - I. Electrical contractor license as a when required.
 - J. Tools & tackle Certificate.
 - K. At least Rs. 10 Lacs turn over required in bank Statement.
 - L. Proof regarding payment of Tender Fee and EMD. The above supplementary documents should be submitted in form of attested true copies.
- 3 The Price bid should be submitted in physically form. This is mandatory if price bids submitted in physically form same will not be open and only online submitted price bid will be considered for evaluation.
 - 4 Both “Technical” and” EMD Receipt No. should be submitted in one common envelope super scribing the name of the work and tender opening date etc.
 - 5 Earnest money deposit of Rs. 10000 should be deposited in cash or submitted in form of Demand Draft in favor of UTTAR GUJARAT VIJ COMPANY LIMITED drawn on any scheduled Bank, payable at **Radhanpur**
 - 6 Bidders should complete the tender documents in all respects and they are to be signed with Company’s Seal on all pages.

- 7 The bidders shall submit their offer without any deviations in general terms and conditions of the contract or in Technical specification/items. Tenders of such departing may also be rejected. Incomplete and conditional tenders shall not be considered.
- 8 UTTAR GUJARAT VIJ COM.LTD. Reserves the right to split up the work covered in the scope of this contract amongst more than one contractor.
- 9 The rates shall be quoted both in words and figures as per unit specified in schedule-'B' and it should be stucked by the transparent cello tape. In case of any discrepancy between the rates quoted in words & figures, rate quoted in words will prevail.
- 10 Intending bidders should submit their tenders after studying all tenders documents carefully and visiting the site for satisfying themselves of actual site conditions, location and accessibility of site and nature, extent of the work involved etc. Submission of tenders implies that bidders have obtained all necessary.
- 11 Information and other data required for executing the work. No claim for extra charges on account of any misunderstanding or otherwise will be allowed.
- 12 All approaches to the site shall be in the scope of bidders. Bidders will not be allowed to give sub-contract of the works awarded to him for any, reasons what so ever without permission of the Engineer-in charge.
- 13 In the experience certificate, contractor has to furnish the details of similar works executed by him along with the list of equipment, tools and tackles and manpower available with him along with the details of the same, which he intends to deploy on site of the work.
- 14 After opening of "Technical bid" no revised price bid from any bidders will be accepted.
- 15 Price quoted shall be firm, till overall completion of the work, under contract and there will not be any price escalation.
- 16 Date of opening of "Price Bid" will be intimated later on to those Bidders who are qualified in technical bid. "Price bid" of only qualifying bidders on the basis of Technical bid shall only be opened. Price of bidders, who are not qualified technically as per requirement of technical bid shall not be opened.
- 17 Offers shall be valid for the period of 120 days from the date of opening of price bid. Tenders shall not withdraw tenders during the validity period, failing which their EMD shall be forfeited during the said period of 120 days.
- 18 Bolts & nuts of appropriate size and quality will be supplied by the **UGVCL Company if possible.**
- 19 Cement will be issued as per Company existing rates.
- 20 Materials will be issued strictly as per requirement & not in lot
- 21 Concrete slabs will be supplied from our store.0.50 "ps. Per cu ft will be paid below the 2 feet or ground level for the rocky soil against the certificate of Dy. Engineer in charge/verification by concern D.E. tech of Radhanpur Division.
- 22 Due care should be taken while doing the work, If any accident will occurred to your employee/personal while working than it will be your responsibility. Company will not be responsible for payment of any claims due to such accident.
- 23 Contractor should observe labour laws as per prevailing rules of Govt. of Gujarat.
- 24 Tree Branches should be trimmed such a way that distance of nearby conductor and trimmed branch must remain 5' Horizontal and 5' vertically.
- 25 Pin binding of Pin Insulator must be with double strand of conductor.
- 26 Each and every shackle pole must be re jumpered with formation of 'D'.
- 27 Old material removed from line (If any) must be credited in Divn. Store.
- 28 All tools, tackles used in maintenance will be provided by contractor.

- 29 Transportation of labour for the work should be done by contractor.
- 30 If necessary order of one S/Dn. will be transferred to other S/Dn. depending upon requirement of UGVCL.
- 31 The clearance as per I.E rules must be maintained.
- 32 For any dispute jurisdiction of legal will be at **Radhanpur/**
- 33 If the Tenderer/Bidder/Contractor would stand lowest while opening of the tender, He will be intimated by the competent authority with separate letter & will have to provide their skilled Labours gang within week time & He would have to report in written through respective SDO. Otherwise Second lowest bidder will be given chance at the rate of lowest-1.
- 34 The contractor should have to keep permanently skilled Labours gang in respective Sub-Division for each annual order. If Concern SDO will report that Erection Work is delayed due to non-availability of skilled labour , penalty will be deducted a per rules.
- 35 All the works shall be carried out as per specifications attached with the tender and relevant Indian Standard issued by Bureau Indian Standards. All materials procured should be confirming to relevant Indian Standard issued by Bureau of Indian Standard.
- 36 Tenders, who do not fulfill all or any of the conditions of the tender of incomplete in any respect, are liable to rejection.
- 37 UTTAR GUJARAT VIJ COMPANY LTD, reserves the right to reject any or all Tenders without assigning any reason thereof.
- 38 Income Tax at prevailing Rate will be deducted as per Income tax Act.
- 39 The rates are inclusive of PF and all other State/Central Government taxes, cess and levies but exclusive of **CGST/SGST**. **CGST/SGST** prevailing rate, if applicable will be reimbursed by UGVCL on production of **CGST/SGST** paid Challan.

Contractor shall have to strictly follow all the instructions, terms & conditions of concern Authority and the necessary approval/NOC etc, is to be obtained by the contractor from the concern Authority own cost.

**Signature of Tenderer
With Rubber Stamp.**

**EXECUTIVE ENGINEER
UGVCL, RADHANPUR DO**