

No.	PART NAME	QTY.	SIZE	MATERIAL	REMARKS
19	OPERATING PIPE	1	25 NB X 6000	GALV. PIPE	'B' CLASS
18	EARTHING TERMINAL	3	3/8" BOLT	-	ELE'TE GALV.
17	MOUNTING HOLE (115MM C.D.)	6	Ø18MM HOLE	-	-
16	11 KV POLYMERIC POST INSU.	6	320MM C.D.	POLYMERIC	-
15	TERMINAL CONNECTOR	6	-	ALLUMINUM	-
14	OPERATING HANDLE	1	-	M.S.	HOTDIP GALV.
13	BEARING BUSH	6	-	BRASS	-
12	PHASE CONNECTING Sq. PIPE	1	25 X 25 X 2000	M.S. SQ. PIPE	HOTDIP GALV.
11	SPRING	6	ID 12 MM X 1.5 Thk.	STAINLESS STEEL	-
10	FEMALE CONTACT GUARD	6	Fabricated	M.S.	HOTDIP GALV.
9	ANGULAR BASE FOR FEMALE	3	-	M.S.	HOTDIP GALV.
8	FIXED FEMALE CONTACT	6	35 X 3MM	EC COPPER	SILVER PLATE
7	FEMALE CONTACT BASE	3	-	GM CASTING	TIN PLATED
6	MALE CONTACT BASE	3	-	GM CASTING	TIN PLATED
5	TILTING BASE	3	AS PER DWG.	CAST IRON	ELE'TE GALV.
4	MOVING MALE CONTACT	3	35 X 6 MM	EC COPPER	SILVER PLATED
3	BEARING PLATE	6	-	M.S.	HOTDIP GALV.
2	ARCING HORN	6	Ø 10 MM	M.S. ROD	HOTDIP GALV.
1	MOUNTING BASE CHANNEL	3	75 X 40 X 410	M.S.	HOTDIP GALV.

NOTES :

1. ALL DIMENSIONS ARE IN MM.
2. GENERAL DIMS. TOLERANCE SHALL BE $\pm 5\%$, MIN. 1 MM.
3. ONLY POSITIVE TOLERANCE SHALL BE ALLOW FOR CURRENT CARRYING PARTS.



**DAKSHIN GUJARAT
VIJ CO. LTD.**


TITAL: GENERAL ARRANGEMENT DRG FOR11
KV AIR BREAK SWITCH [400AMP] WITH
POLYMERIC INSULATOR

Drg. No.

DGVCL/11KV/PABS/17

SHEET

1 OF 2

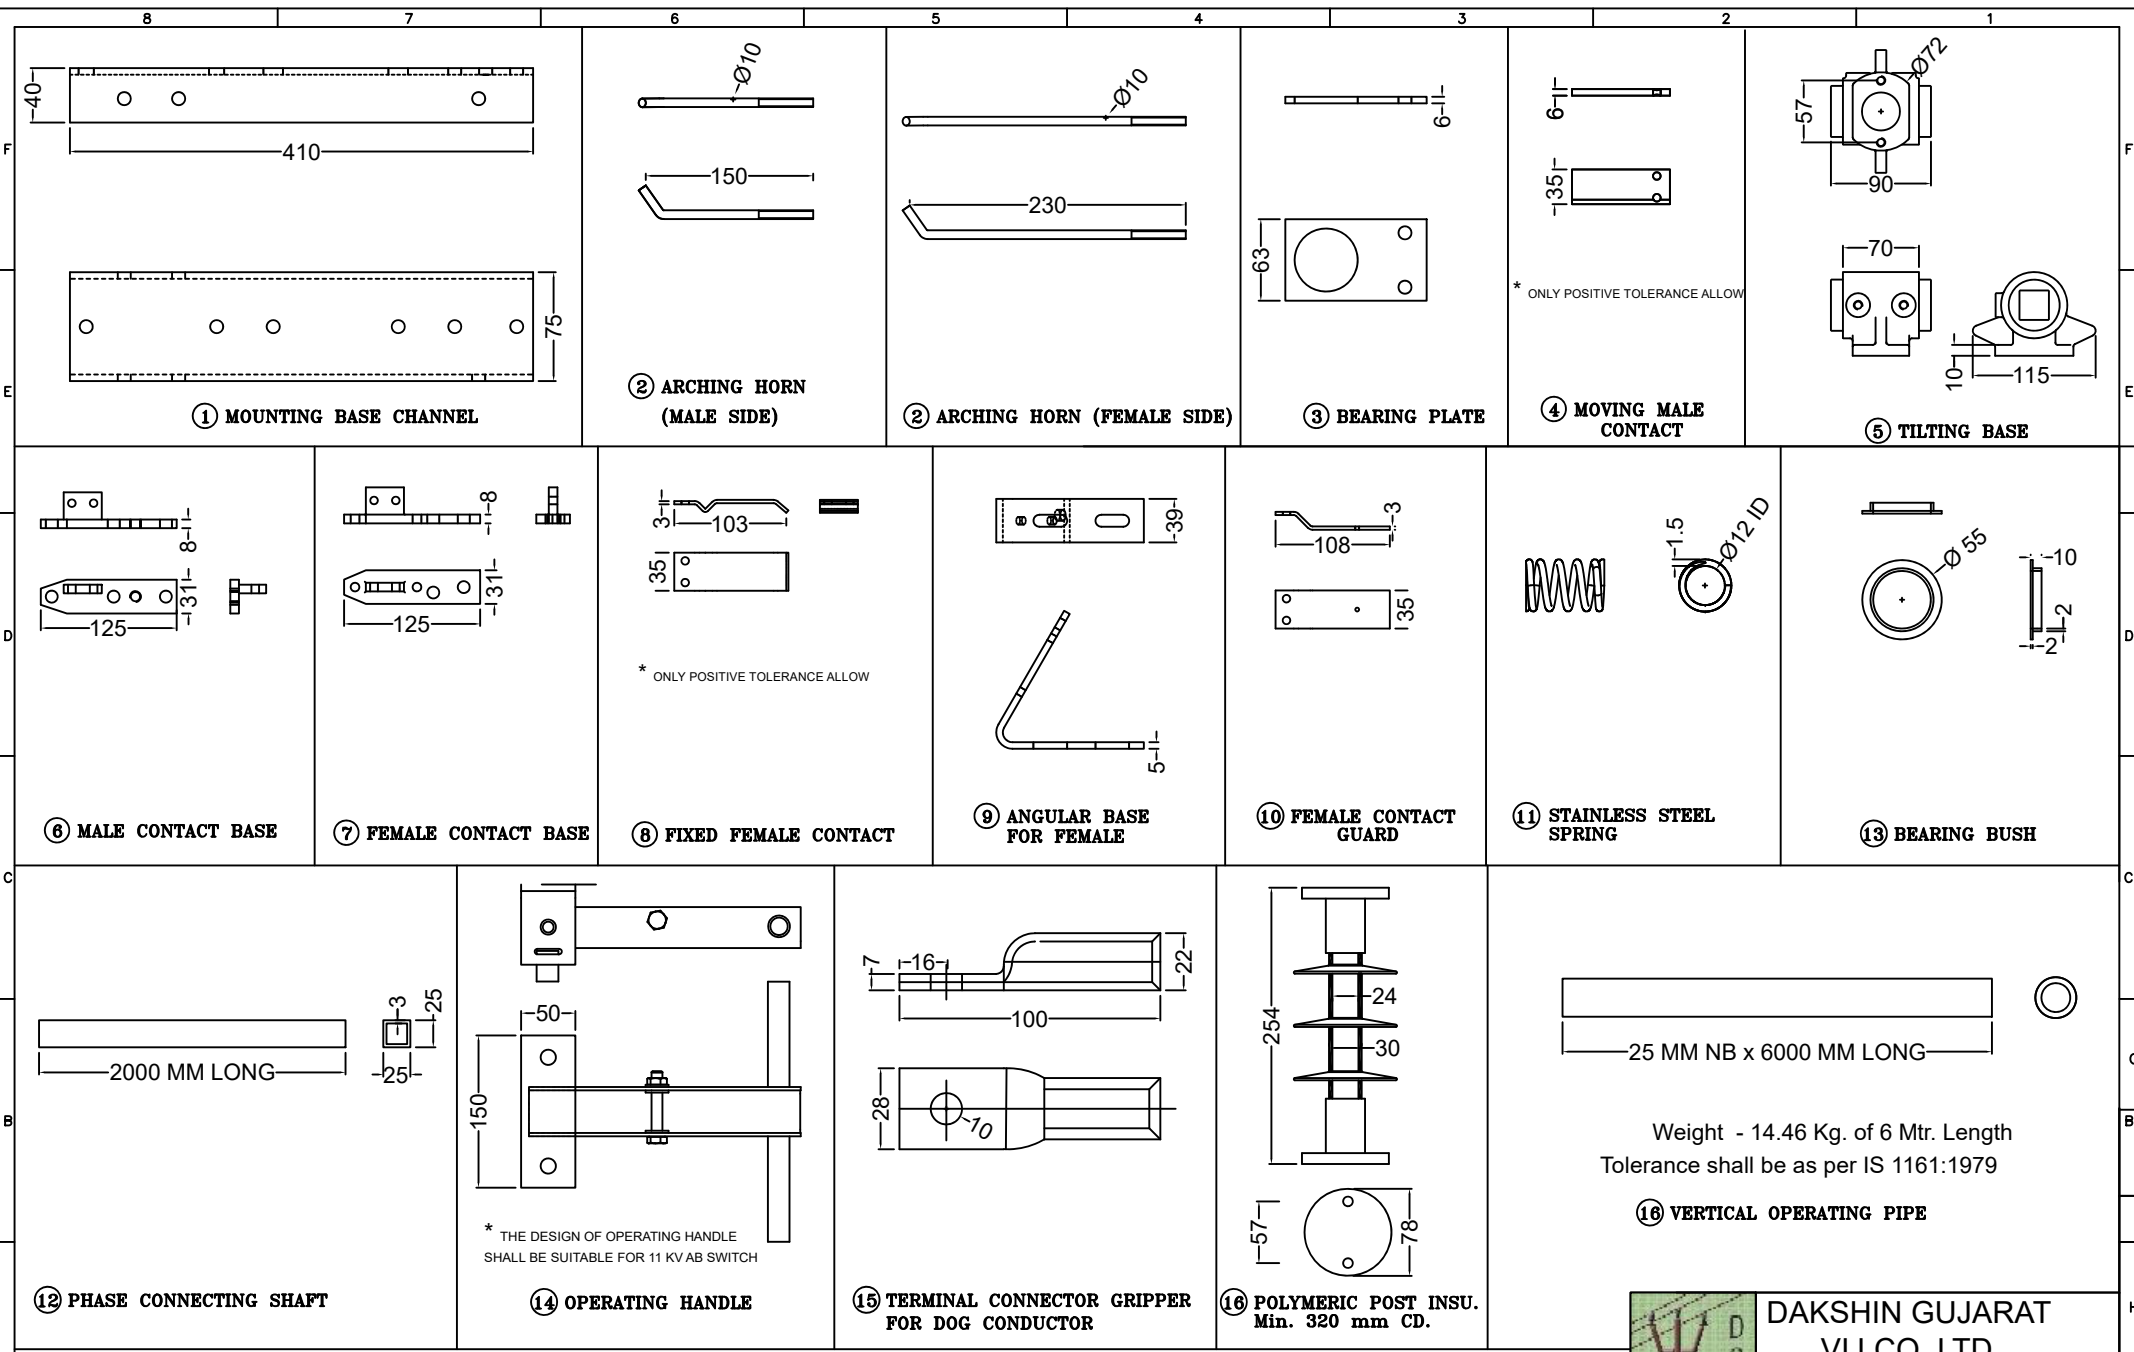


* ONLY POSITIVE TOLERANCE ALLOW

* ONLY POSITIVE TOLERANCE ALLOW

* THE DESIGN OF OPERATING HANDLE SHALL BE SUITABLE FOR 11 KV AB SWITCH

- NOTES :**
1. ALL DIMENSIONS ARE IN MM.
 2. GENERAL DIMS. TOLERANCE SHALL BE $\pm 5\%$, MIN. 1 MM.
 3. "****" ONLY POSITIVE TOLERANCE SHALL BE ALLOW FOR CURRENT CARRYING PARTS.



DAKSHIN GUJARAT VIJ CO. LTD.

TITAL: GENERAL ARRANGEMENT DRG FOR 11 KV AIR BREAK SWITCH [400AMP] WITH POLYMERIC INSULATOR

Drg. No.	SHEET
DGVCL/11KV/PABS/17	2 OF 2