UGVCL/SP/III/ /HT-LT STAY INSULATORS

140 X 85 GUY STRAIN INSULATOR

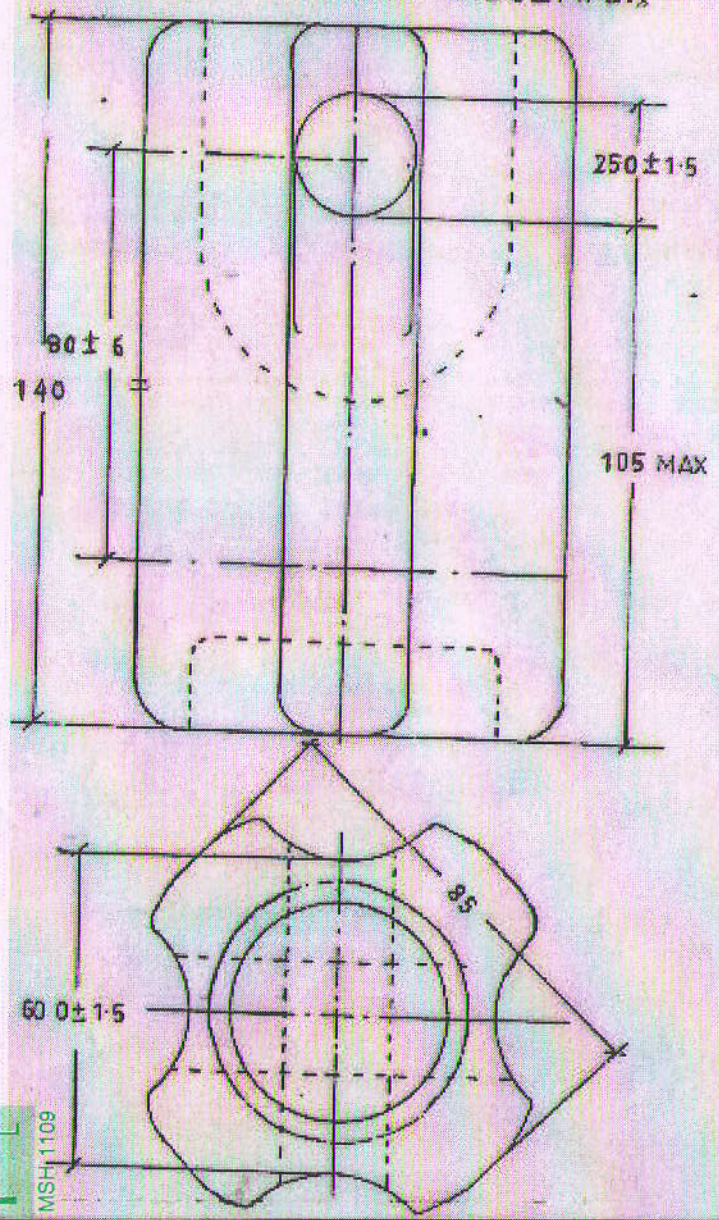

NOTES

1. APPLICABLE STANDARDE DESIGNATION	IS C	5300/1969 FIG-3
2. COLOUR OF GLAZE		BROWN
3. SIZE OF INSULATOR	MM	140x85
4. LENGTH	MM	140
5. DIAMETER	MM	85
6. CABLE HOLD	MM	25
7. MIN FAILING LOAD	KN	88
8. P.F. WITHSTAND VOLTAGE DRY	KV	27 (rms)
9. P.F. WITHSTAND VOLTAGE WET	KV	13 (rms)
10. MARKING AS PER IS	IS	5300/1969 88 KN MONTH/YEAR
11. ALL DIMENSION ARE IN	MM	

UTTAR GUJARAT VIJ COMPANY LIMITED
Regd.&Corp.Office, Visnagar Road,
MEHSANA - 384 001 (North Gujarat)

GUJARAT ELECTRICITY BOARD
HEAD OFFICE — VADODARA-7

DRAWN: DATE 17-7-04
CHECKED: 19.7 D.E.
APPRVD: 19/7 C.E.
DRG. NO. O.&M X
R.O.

RO MSH 1109