
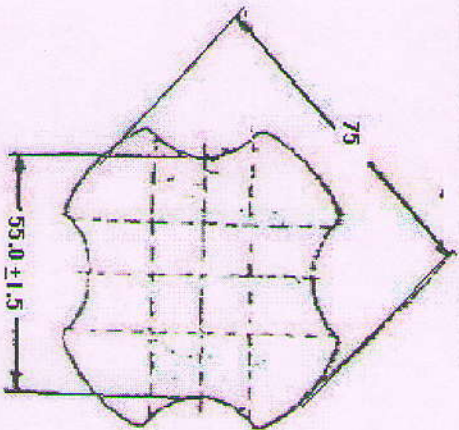


UTTAR GUJARAT VIJ COMPANY LIMITED

Regd. & Corp. Office, VISNAGAR ROAD, Mehsana

PURCHASE OF HT-LT STAY INSULATORS (TENDER NO: UGVCL/SP/1109)

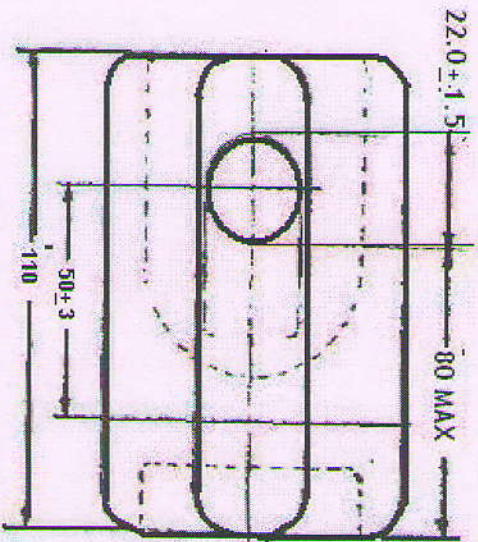

LT GUY STRAIN INSULATOR IS 5300 : 1969

GUARANTEED TECHNICAL PARTICULARS

1	IS Specification	IS:5300/1969 Fig - 2
2	Dimensions (Size of Insulators)	110 x 75 mm
3	Colour of Glaze	White / Brown
4	Cable Hole Diameter	22mm
5	Dry Power Frequency Withstand Voltage	22 KV (rms)
6	Wet Power Frequency Withstand Voltage	09 KV (rms)
7	Power Frequency Puncture Withstand Voltage	As per IS:5300/1969
8	Minimum Failing Load	53 KN (5400 Kg)
9	Creepage Distance (Minimum)	48 mm (Min.)
10	Weight (Approx)	0.750 Kg (Approx.)

All Dimensions are in mm.